


# Duck River Electric Membership Corporation

## Typical Overhead Temporary Service

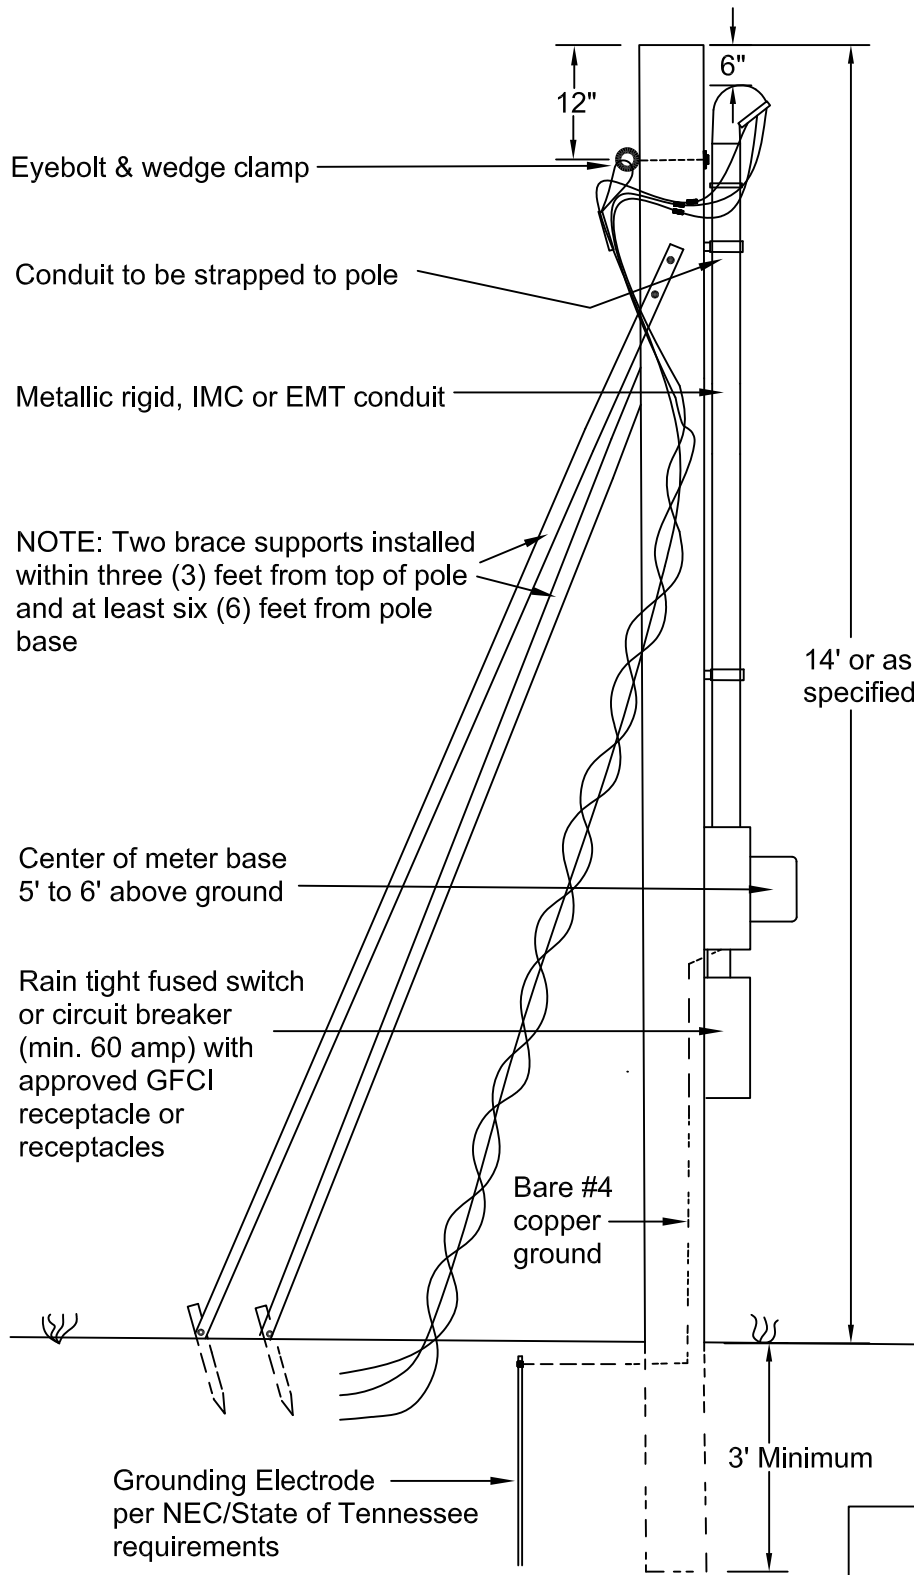

**NOTES:**

1. Temporary service pole must be spotted by DREMC.
2. All customer owned facilities must be in compliance with the provisions of this sketch or the National Electrical Code, whichever is more stringent. All wiring must be approved by the state wiring inspector.
3. It is recommended that the neutral not be cut in meter base.
4. The pole must be a minimum of 17' and can be a round pole or a 4 x 4 or larger post.
5. DREMC will provide a length of triplex conductor, along with an eyebolt, connectors, and wedge clamp for attachment to temporary pole. DREMC will not make up connections at top of temporary pole.
6. DREMC will require the temporary service pole to be re-inspected by the Deputy Electrical Inspector if the temporary has been in the field for one (1) year.

<b>DREMC</b>	
Revision: _____	
Issued By: _____	
Received By: _____	
Date: _____	