


# Duck River Electric Membership Corporation

## Requirements for Underground Residential Service

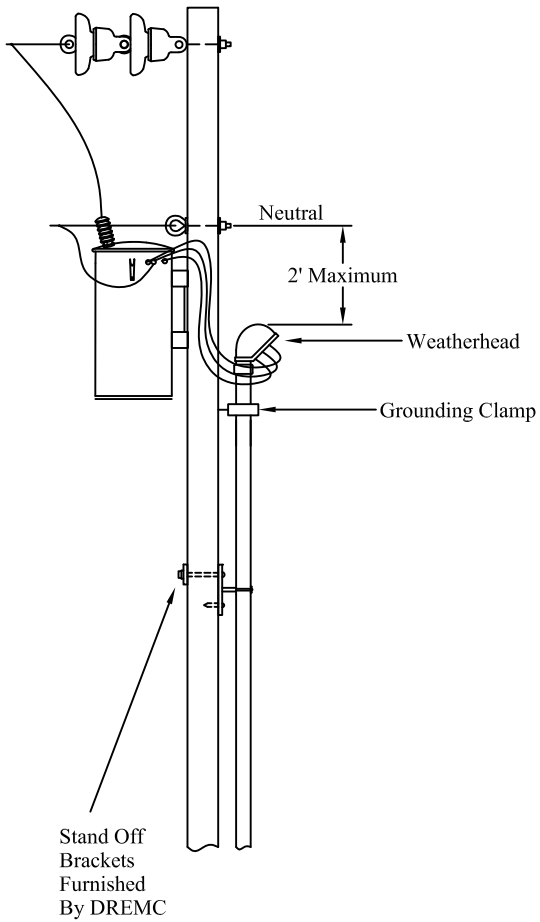

### Member to Furnish & Install

- Metallic Rigid Conduit & Straps on Exterior Wall
- Schedule 40 Electrical PVC between elbows
- Minimum 24" Radius Metallic Rigid Sweeps
- Install Pull Rope in Conduit (1/4" Polypropylene)

### Member to Furnish & Leave by Pole

- Metallic Rigid Conduit Per Specified Size & Length
- Weatherhead
- Conduit Grounding Clamp

### Metallic Rigid Conduit Length

- Conduit Length \_\_\_\_\_  
(DREMC Engineer to specify length)

### Conduit Size

- 225 Amp or less - 2 1/2"
- 400 Amp - 3 1/2"
- 600 Amp - 4" (Unless specified differently by DREMC Engineer)

